


# Basic hydronic underfloor thermal storage floating slab

## 8-12 hours of control

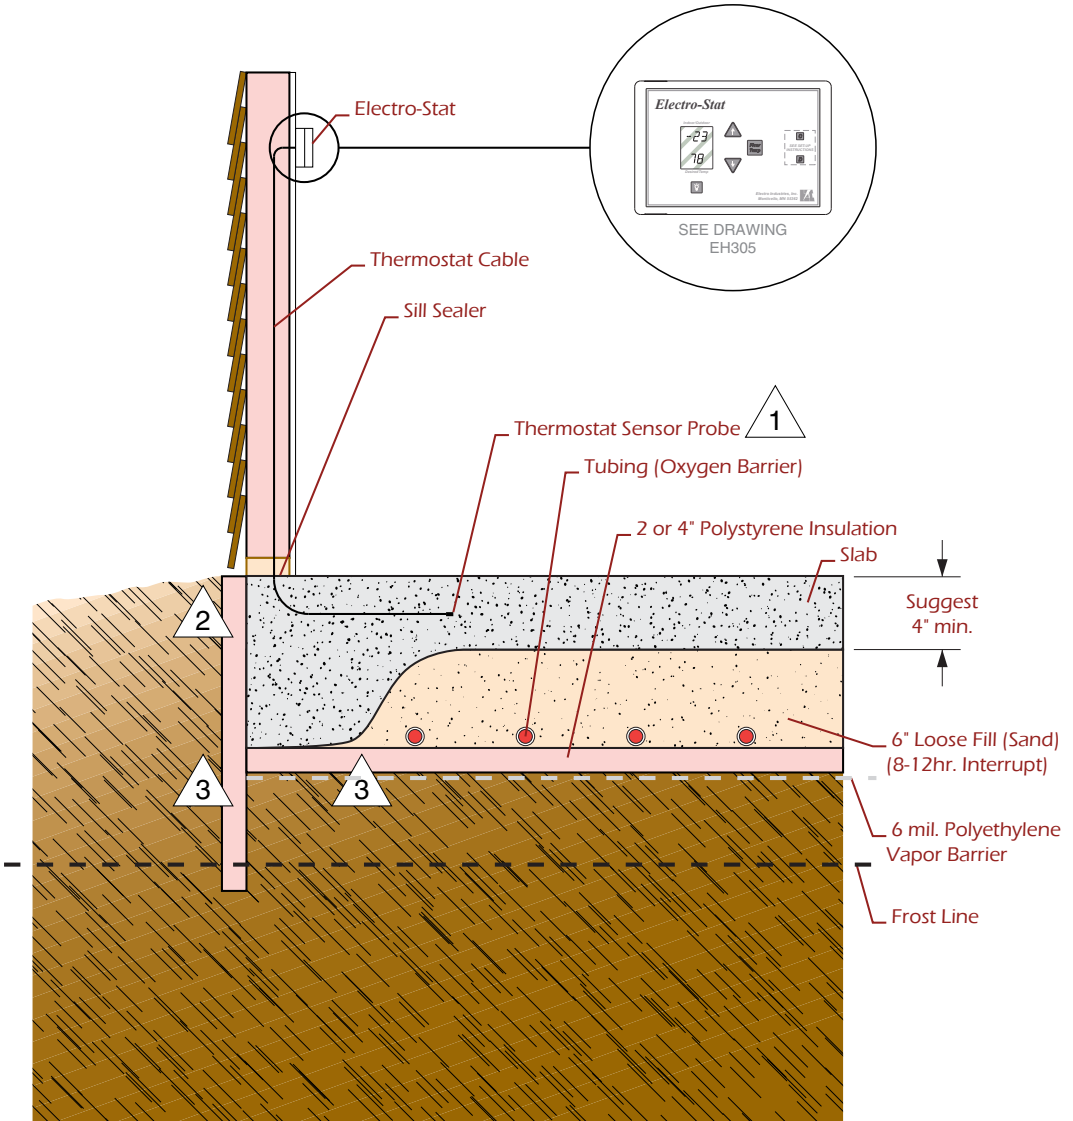

### Notes:

1. Conduit required within slab, 3/4" with sweep ell.
2. If "floating slab", need screen to prevent rodent entry.
3. bottom or flat insulation board can also be extended 2'-3' outside of the slab. rodent screen becomes more difficult with this concept.

Source: Electro Industries, Inc.  
Monticello, MN